


VISITOR CENTRE SUBSTATION (SUBSTATION- 08):
51N RELAY SETTING CURVE

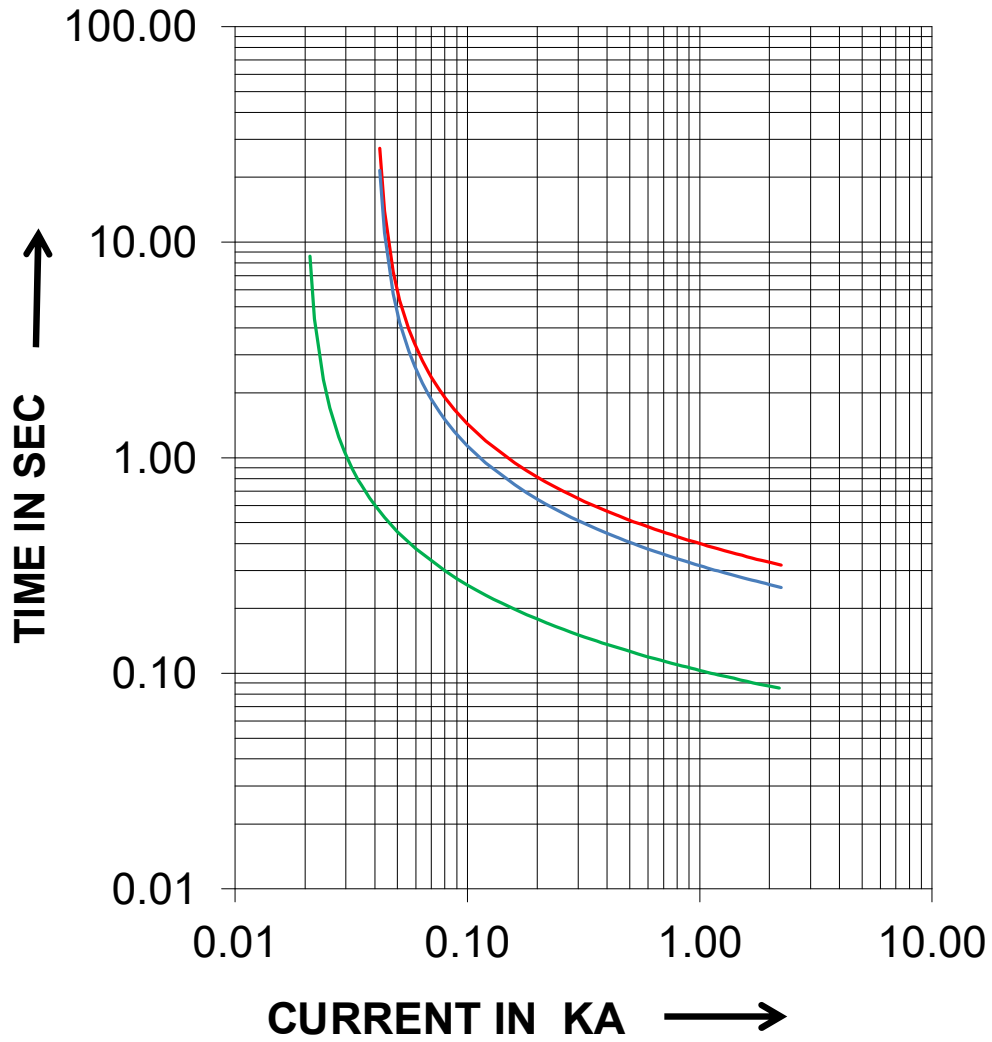

- INTERCONNECTOR FEEDER (H03, H07)
- O/G TO 1.6 MVA TR. (H01, H02, H08)
- BUS COUPLER (H05)